

GFK-2063
New In Stock!
~~GE Fanuc Manuals~~

[http://www.pdfsupply.com/automation/ge-fanuc-manuals/series-90-70-9070/-](http://www.pdfsupply.com/automation/ge-fanuc-manuals/series-90-70-9070/)

[GFK-2063](#)
series-90-70-9070
1-919-535-3180

IC697VDR150/151 Relay Output

www.pdfsupply.com

Email: sales@pdfsupply.com



GE Fanuc Automation

Programmable Control Products

IC697VDR150 / IC697VDR151 Relay Board with BIT

User's Manual

GFK-2063

514-000441-000 A

December 2001

Warnings, Cautions, and Notes as Used in this Publication

Warning

Warning notices are used in this publication to emphasize that hazardous voltages, currents, temperatures, or other conditions that could cause personal injury exist in this equipment or may be associated with its use.

In situations where inattention could cause either personal injury or damage to equipment, a Warning notice is used.

Caution

Caution notices are used where equipment might be damaged if care is not taken.

Note

Notes merely call attention to information that is especially significant to understanding and operating the equipment.

This document is based on information available at the time of its publication. While efforts have been made to be accurate, the information contained herein does not purport to cover all details or variations in hardware or software, nor to provide for every possible contingency in connection with installation, operation, or maintenance. Features may be described herein which are not present in all hardware and software systems. GE Fanuc Automation assumes no obligation of notice to holders of this document with respect to changes subsequently made.

GE Fanuc Automation makes no representation or warranty, expressed, implied, or statutory with respect to, and assumes no responsibility for the accuracy, completeness, sufficiency, or usefulness of the information contained herein. No warranties of merchantability or fitness for purpose shall apply.

The following are trademarks of GE Fanuc Automation North America, Inc.

Alarm Master	Genius	PROMACRO	Series Six
CIMPLICITY	Helpmate	PowerMotion	Series Three
CIMPLICITY 90-ADS	Logicmaster	PowerTRAC	VersaMax
CIMSTAR	Modelmaster	Series 90	VersaPro
Field Control	Motion Mate	Series Five	VuMaster
GEnet	ProLoop	Series One	Workmaster

Contents

Chapter 1	Introduction, Description, and Specifications	1-1
	Reference Material and Other GE Fanuc Manuals.....	1-1
	General Description	1-2
	Functional Description	1-3
	Safety Summary	1-4
Chapter 2	Configuration and Installation.....	2-1
	Physical Installation	2-2
	Jumper Installations	2-3
	Connector Configuration.....	2-7
Chapter 3	Programming.....	3-1
	Introduction.....	3-2
	Register Map	3-3
	Built-in-Test	3-8
Chapter 4	Theory of Operation	4-1
	Internal Functional Organization	4-2
	Foundation Logic	4-3
	Output Registers and Relays	4-8
	Built-in-Test (BIT).....	4-9
Chapter 5	Maintenance.....	5-1

Chapter 1

Introduction, Description, and Specifications

This manual describes the features, installation, and operation of the following relay output modules with built-in test logic:

Part Number	Channels	Connectors	Contact Type
IC697VDR150	32 channels	two 96-pin DIN connectors	Non-latching
IC697VDR151	64 channels	two 96-pin DIN connectors	Non-latching

Reference Material and Other GE Fanuc Manuals

For a detailed explanation of the VMEbus and its characteristics, “The VMEbus Specification” is available from:

VITA
VMEbus International Trade Association
7825 East Gelding Dr., No. 104
Scottsdale, AZ 85260
(480) 951-8866
FAX: (480) 951-0720
Internet: www.vita.com

The following Application Guide is available from GE Fanuc to assist in the selection, specification, and implementation of systems based upon GE Fanuc’s products:

Connector and I/O Cable Application Guide (catalog number GFK-2085)	Describes I/O connections that can be used with GE Fanuc’s VMEbus products. Includes connector compatibility information and examples.
---	--

General Description

The Relay Board is VMEbus-compatible. Some of the board's other features include:

- 1 Form C contacts (SPDT)
- 2.0 A / 60 W contact rating
- Protection from relays changing during power changes
- BIT checks the contacts as well as the driving registers
- 8-, 16-, or 32-bit Data Transfers
- User selected Short I/O or Standard Data addressing
- User selected supervisory, nonprivileged, or either access

Two 96-pin DIN compatible connectors are provided on the board and are accessible from the front panel. Each relay uses one row of pins. The A column connects to the NO (normally open) contact, the B column connects to the NC (normally closed) contact, and the C column connects to the Common contact. A 64-conductor cable can be used to switch the Normally Open, 1 Form A (SPST) contacts.

Functional Description

The Relay Board is a digital output board. Writing a logic "one" to a register on the board will activate the associated relay. When a relay is activated, its Normally Open (NO) contacts close and its Normally Closed (NC) contacts open. Writing a logic "zero" to a register will deactivate the relay and its contacts will return to their normal positions.

The Relay Board consists of VMEbus foundation logic, data output control logic, relays, and BIT logic. The foundation logic conforms to the VMEbus requirements and contains the board select and data steering logic. The data output control logic decodes the desired on-board register the data goes to and stores the data. The relays have their contacts available at the two front panel connectors. The BIT logic tests the Data Output Registers by using a built-in feedback function in the chip. The BIT logic monitors a second set of relay contacts, allowing BIT to test the relays and their driving logic.

Safety Summary

Warning

The following general safety precautions must be observed during all phases of operation, service, and repair of this product. Failure to comply with these precautions or with specific warnings elsewhere in this manual violates safety standards of design, manufacture, and intended use of this product. GE Fanuc assumes no liability for the customer's failure to comply with these requirements.

Ground the System

To minimize shock hazard, the chassis and system cabinet must be connected to an electrical ground. A three-conductor AC power cable should be used. The power cable must either be plugged into an approved three-contact electrical outlet or used with a three-contact to two-contact adapter with the grounding wire (green) firmly connected to an electrical ground (safety ground) at the power outlet.

Do Not Operate in an Explosive Atmosphere

Do not operate the system in the presence of flammable gases or fumes. Operation of any electrical system in such an environment constitutes a definite safety hazard.

Keep Away from Live Circuits

Operating personnel must not remove product covers. Component replacement and internal adjustments must be made by qualified maintenance personnel. Do not replace components with power cable connected. Under certain conditions, dangerous voltages may exist even with the power cable removed. To avoid injuries, always disconnect power and discharge circuits before touching them.

Do Not Service or Adjust Alone

Do not attempt internal service or adjustment unless another person, capable of rendering first aid and resuscitation, is present.

Do Not Substitute Parts or Modify System

Because of the danger of introducing additional hazards, do not install substitute parts or perform any unauthorized modification to the product. Return the product to GE Fanuc for service and repair to ensure that safety features are maintained.

Chapter 2

Configuration and Installation

This chapter, divided into the following sections, provides configuration and installation instructions for the Relay Board:

- Physical Installation
- Jumper Installations
- Connector Configuration

Caution

Some of the components assembled on GE Fanuc products can be sensitive to electrostatic discharge and damage can occur on boards that are subjected to a high-energy electrostatic field. When the board is placed on a bench for configuring, etc., it is suggested that conductive material be placed under the board to provide a conductive shunt. Unused boards should be stored in the same protective boxes in which they were shipped.

Upon receipt, any precautions found in the shipping container should be observed. All items should be carefully unpacked and thoroughly inspected for damage that might have occurred during shipment. The board(s) should be checked for broken components, damaged printed circuit board(s), heat damage, and other visible contamination. All claims arising from shipping damage should be filed with the carrier and a complete report sent to GE Fanuc together with a request for advice concerning the disposition of the damaged item(s).

Physical Installation

Caution

Do not install or remove board while power is applied.

De-energize the equipment and insert the board into an appropriate slot of the chassis. While ensuring that the board is properly aligned and oriented in the supporting board guides, slide the board smoothly forward against the mating connector until firmly seated.

Jumper Installations

There are 22 jumper positions in one header located in the middle of the bus side of the board. Figure 2-1 on page 2-4 shows the relative position of this header. Each jumper position is labeled on the board as shown in Figure 2-2 on page 2-5. This figure is an enlarged view of the silkscreen text. To configure the board, first determine what address range the board will occupy. If the board goes in the Standard Data address space, install a jumper in the SHT/ STD I/O position. This is the jumper closest to the edge of the board. The board is shipped from the factory using the Short I/O address space as shown in Figure 2-3 on page 2-5.

The next jumper installation is based on which access mode the board will use. Boards that use the Nonprivileged only mode will have a jumper placed in the AM2 position. This is the third jumper from the edge of the board. Figure 2-4 on page 2-5 shows this jumper. Boards that will use either Nonprivileged or Supervisory modes will have a jumper placed on the "(AM2/ AM2)" position. This is the second jumper from the edge of the board. The board is shipped from the factory configured to respond to both supervisory and nonprivileged accesses as shown in Figure 2-5 on page 2-6. For boards that use Supervisory only mode, no jumper would be used in these places. If both jumpers are installed, the board will respond to nonprivileged accesses.

The remaining 19 jumper positions correspond to the address line listed beside the jumper. These jumpers create the base address of the board. Place a jumper on the posts in the position where an address line is to be "zero" in the base address of the board. For boards that use Short I/O addresses, jumpers placed on the posts in the positions A16 through A23 have no effect. They are not used. Of course, for boards using Standard Data addresses, these jumpers are used. Figure 2-7 on page 2-6 shows a Short I/O address of A5C0 HEX.

Figure 2-1: Jumper Locations

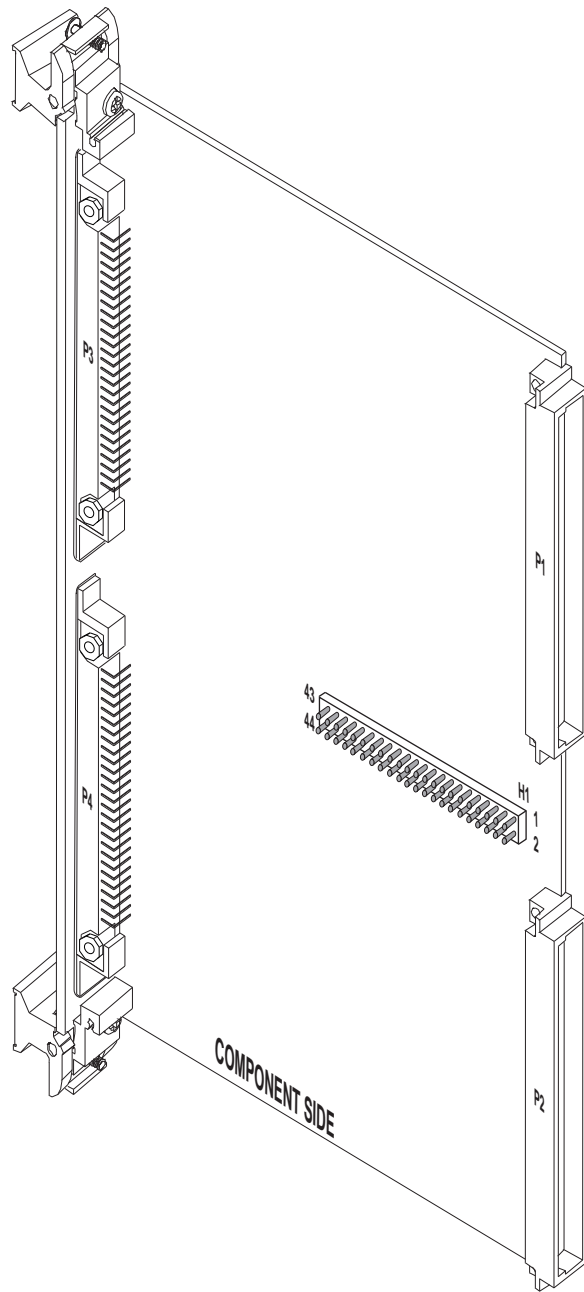


Figure 2-2: Jumper Labels

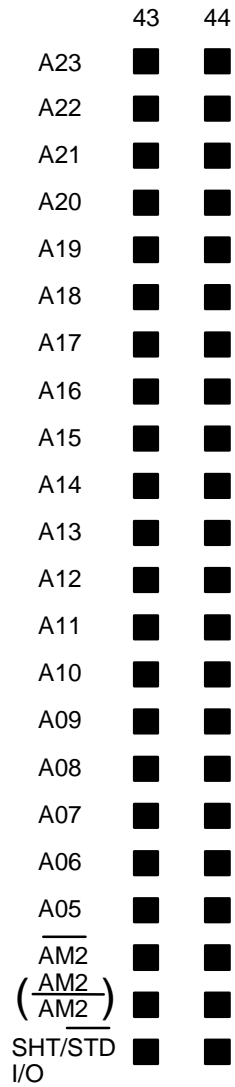


Figure 2-3: SHT/STD I/O Jumper Factory Configuration




Figure 2-4: Nonprivileged Only Mode Configuration




Figure 2-5: Either Access Mode Configuration

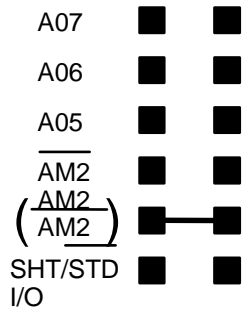


Figure 2-7: Typical Board Configuration


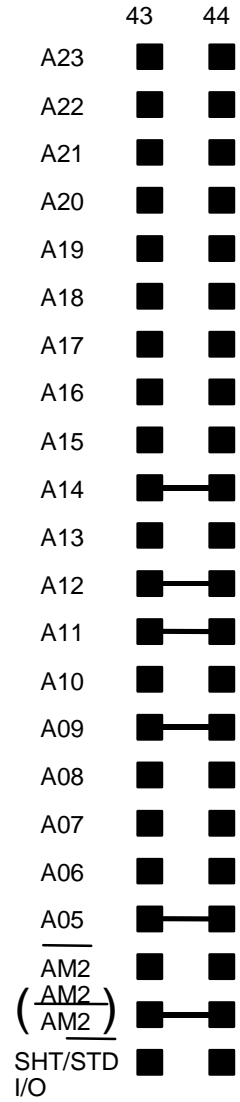


Figure 2-6: AM2 Configuration Error

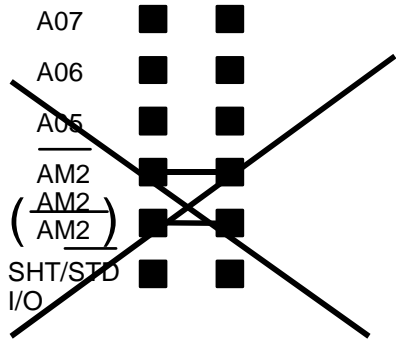


This will cause a system malfunction.

The configuration is for a Short I/O Board using either access mode with a base address of \$A5C0.

Connector Configuration


The Relay Board uses two 96-pin DIN connectors on the front panel. These connectors can be used with a discrete wire connector housing and shell from HARTING ELEKTRONIK INC. or a mass-terminated cable and connector from ERNI components. The specification sheet for this board contains detailed ordering information about these connectors and cables. These cables and connectors will bring out all of the contacts from the board. The contacts are configured as 1 Form C (SPDT); however, the connector layout shown in Figure 2-8 below and Figure 2-9 on page 2-8 permits a 64-conductor cable and full C DIN connector to bring out the contacts as a 1 Form A (SPST N.O.).

Figure 2-8: P3's Connector Layout and Pin Assignments

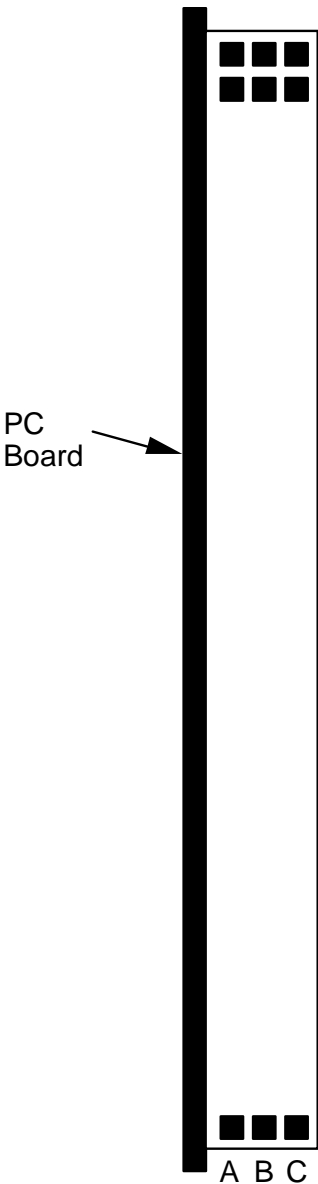

Column A	Column B	Column C	Channel
A32 – N.O.	B32 – N.C.	C32 – COMM	CHNL 63
A31 – N.O.	B31 – N.C.	C31 – COMM	CHNL 62
A30 – N.O.	B30 – N.C.	C30 – COMM	CHNL 61
A29 – N.O.	B29 – N.C.	C29 – COMM	CHNL 60
A28 – N.O.	B28 – N.C.	C28 – COMM	CHNL 59
A27 – N.O.	B27 – N.C.	C27 – COMM	CHNL 58
A26 – N.O.	B26 – N.C.	C26 – COMM	CHNL 57
A25 – N.O.	B25 – N.C.	C25 – COMM	CHNL 56
A24 – N.O.	B24 – N.C.	C24 – COMM	CHNL 55
A23 – N.O.	B23 – N.C.	C23 – COMM	CHNL 54
A22 – N.O.	B22 – N.C.	C22 – COMM	CHNL 53
A21 – N.O.	B21 – N.C.	C21 – COMM	CHNL 52
A20 – N.O.	B20 – N.C.	C20 – COMM	CHNL 51
A19 – N.O.	B19 – N.C.	C19 – COMM	CHNL 50
A18 – N.O.	B18 – N.C.	C18 – COMM	CHNL 49
A17 – N.O.	B17 – N.C.	C17 – COMM	CHNL 48
A16 – N.O.	B16 – N.C.	C16 – COMM	CHNL 47
A15 – N.O.	B15 – N.C.	C15 – COMM	CHNL 46
A14 – N.O.	B14 – N.C.	C14 – COMM	CHNL 45
A13 – N.O.	B13 – N.C.	C13 – COMM	CHNL 44
A12 – N.O.	B12 – N.C.	C12 – COMM	CHNL 43
A11 – N.O.	B11 – N.C.	C11 – COMM	CHNL 42
A10 – N.O.	B10 – N.C.	C10 – COMM	CHNL 41
A09 – N.O.	B09 – N.C.	C09 – COMM	CHNL 40
A08 – N.O.	B08 – N.C.	C08 – COMM	CHNL 39
A07 – N.O.	B07 – N.C.	C07 – COMM	CHNL 38
A06 – N.O.	B06 – N.C.	C06 – COMM	CHNL 37
A05 – N.O.	B05 – N.C.	C05 – COMM	CHNL 36
A04 – N.O.	B04 – N.C.	C04 – COMM	CHNL 35
A03 – N.O.	B03 – N.C.	C03 – COMM	CHNL 34
A02 – N.O.	B02 – N.C.	C02 – COMM	CHNL 33
A01 – N.O.	B01 – N.C.	C01 – COMM	CHNL 32

Figure 2-9: P4's Connector Layout and Pin Assignments

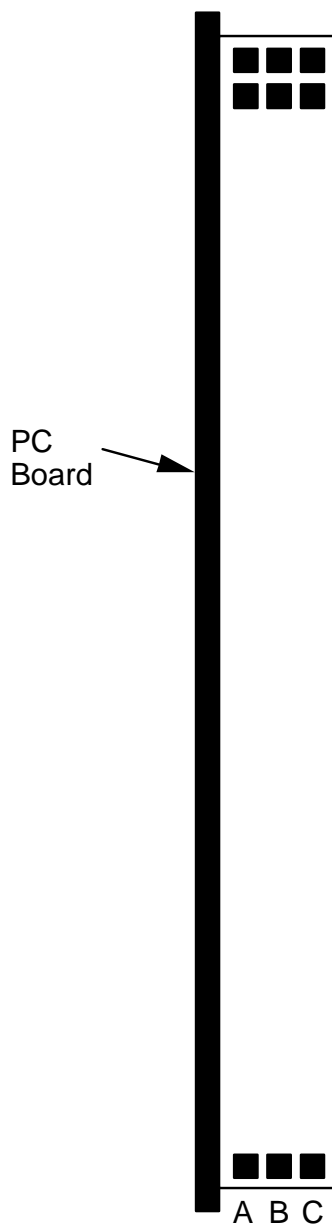

Column A	Column B	Column C	Channel
A32 – N.O.	B32 – N.C.	C32 – COMM	CHNL 31
A31 – N.O.	B31 – N.C.	C31 – COMM	CHNL 30
A30 – N.O.	B30 – N.C.	C30 – COMM	CHNL 29
A29 – N.O.	B29 – N.C.	C29 – COMM	CHNL 28
A28 – N.O.	B28 – N.C.	C28 – COMM	CHNL 27
A27 – N.O.	B27 – N.C.	C27 – COMM	CHNL 26
A26 – N.O.	B26 – N.C.	C26 – COMM	CHNL 25
A25 – N.O.	B25 – N.C.	C25 – COMM	CHNL 24
A24 – N.O.	B24 – N.C.	C24 – COMM	CHNL 23
A23 – N.O.	B23 – N.C.	C23 – COMM	CHNL 22
A22 – N.O.	B22 – N.C.	C22 – COMM	CHNL 21
A21 – N.O.	B21 – N.C.	C21 – COMM	CHNL 20
A20 – N.O.	B20 – N.C.	C20 – COMM	CHNL 19
A19 – N.O.	B19 – N.C.	C19 – COMM	CHNL 18
A18 – N.O.	B18 – N.C.	C18 – COMM	CHNL 17
A17 – N.O.	B17 – N.C.	C17 – COMM	CHNL 16
A16 – N.O.	B16 – N.C.	C16 – COMM	CHNL 15
A15 – N.O.	B15 – N.C.	C15 – COMM	CHNL 14
A14 – N.O.	B14 – N.C.	C14 – COMM	CHNL 13
A13 – N.O.	B13 – N.C.	C13 – COMM	CHNL 12
A12 – N.O.	B12 – N.C.	C12 – COMM	CHNL 11
A11 – N.O.	B11 – N.C.	C11 – COMM	CHNL 10
A10 – N.O.	B10 – N.C.	C10 – COMM	CHNL 09
A09 – N.O.	B09 – N.C.	C09 – COMM	CHNL 08
A08 – N.O.	B08 – N.C.	C08 – COMM	CHNL 07
A07 – N.O.	B07 – N.C.	C07 – COMM	CHNL 06
A06 – N.O.	B06 – N.C.	C06 – COMM	CHNL 05
A05 – N.O.	B05 – N.C.	C05 – COMM	CHNL 04
A04 – N.O.	B04 – N.C.	C04 – COMM	CHNL 03
A03 – N.O.	B03 – N.C.	C03 – COMM	CHNL 02
A02 – N.O.	B02 – N.C.	C02 – COMM	CHNL 01
A01 – N.O.	B01 – N.C.	C01 – COMM	CHNL 00

Chapter 3

Programming

This chapter contains programming instructions for the Relay Board, and is divided into the following sections:

- Introduction
- Register Map
- Built-in-Test

Introduction

Writing a "one" to a particular bit position will activate the associated relay on the 64-channel relay output board. Writing a "zero" to the bit will deactivate the relay. The board has an identity register for system software to automatically determine what boards are in the system. A Control and Status Register is provided for user control of the relay drivers, while a front panel LED may be illuminated by software to detect a faulty board in a system.

All registers can be accessed on read or write cycles. Some of the registers, including the Board Identification Register (BDID) and the Relay Contact Registers, are only valid during read transfers. The board responds to write accesses to these registers but data is not stored.

The 32-channel board (IC697VRD150) uses registers 00 through 31. The unused registers are decoded and the board responds to these transfers, however the data is lost. These registers are noted in the "Register Map" section.

This chapter of the manual uses the dollar sign (\$) to denote hexadecimal numbers.

Register Map

The Board's BDID is located at its base address. A Control and Status Register (CSR) is stacked on the next word boundary. This is followed by the Relay Control or Output Registers beginning at an offset of 10 HEX from the base address of the board. Finally, the Relay Contact Registers are placed at the next word boundary. Table 3-1 below lists these registers with their byte offsets. The offset addresses listed in the register map are relative to the base address the user sets up with the jumpers supplied on header H1. The offsets are shown in hexadecimal. The register names correspond to their control line signal names in the schematic. Table 3-2 on page 3-4 lists the individual bit definitions for these registers and the bit position on the board's internal data bus. These definitions determine what relay is being controlled by a particular register and data line.

Board ID Register

This register is located at the base address of the board and contains a fixed value (\$1Bxx when read as a word from offset \$00). This is for automatic system configuration software.

Table 3-1: Register Map

Offset	Name	Description
\$00	BDID	ID register with fixed data of \$1B.
\$01	RESERVED	Not Used, Reads as XX
\$02	CSR	Controls the relay drivers and front panel LED.
\$03	RESERVED	Not Used, Reads as XX
•	• •	
•	• •	
•	• •	
\$0F	RESERVED	Not Used, Reads as XX
\$10	RELAY_CTRL_REG 0*	Controls relay channels 63 to 56.*
\$11	RELAY_CTRL_REG 1*	Controls relay channels 55 to 48.*
\$12	RELAY_CTRL_REG 2*	Controls relay channels 47 to 40.*
\$13	RELAY_CTRL_REG 3*	Controls relay channels 39 to 32.*
\$14	RELAY_CTRL_REG 4	Controls relay channels 31 to 24.
\$15	RELAY_CTRL_REG 5	Controls relay channels 23 to 16.
\$16	RELAY_CTRL_REG 6	Controls relay channels 15 to 09.
\$17	RELAY_CTRL_REG 7	Controls relay channels 07 to 00.
\$18	RLY_CONTACT_REG 0*	Reads the contacts of relay channels 63 to 56.*
\$19	RLY_CONTACT_REG 1*	Reads the contacts of relay channels 55 to 48.*
\$1A	RLY_CONTACT_REG 2*	Reads the contacts of relay channels 47 to 40.*
\$1B	RLY_CONTACT_REG 3*	Reads the contacts of relay channels 39 to 32.*
\$1C	RLY_CONTACT_REG 4	Reads the contacts of relay channels 31 to 24.
\$1D	RLY_CONTACT_REG 5	Reads the contacts of relay channels 23 to 16.
\$1E	RLY_CONTACT_REG 6	Reads the contacts of relay channels 15 to 08.
\$1F	RLY_CONTACT_REG 7	Reads the contacts of relay channels 07 to 00.

* These registers are not used in the 32-channel version of this board (VRD150).

Table 3-2: Register Bit Definitions

Board ID Register (Offset \$00) BDID							
Bit 31	Bit 30	Bit 29	Bit 28	Bit 27	Bit 26	Bit 25	Bit 24
0	0	0	1	1	0	1	1

Board ID Register (Offset \$02) CSR							
Bit 15	Bit 14	Bit 13	Bit 12	Bit 11	Bit 10	Bit 09	Bit 08
Fail LED OFF	TEST MODE P4 OFF	TEST MODE P3 OFF	Not Used				

(Offset \$10) RELAY_CTRL_REG 0*							
Bit 31	Bit 30	Bit 29	Bit 28	Bit 27	Bit 26	Bit 25	Bit 24
SET RELAY CHNL 63	SET RELAY CHNL 62	SET RELAY CHNL 61	SET RELAY CHNL 60	SET RELAY CHNL 59	SET RELAY CHNL 58	SET RELAY CHNL 57	SET RELAY CHNL 56

(Offset \$11) RELAY_CTRL_REG 1*							
Bit 23	Bit 22	Bit 21	Bit 20	Bit 19	Bit 18	Bit 17	Bit 16
SET RELAY CHNL 55	SET RELAY CHNL 54	SET RELAY CHNL 53	SET RELAY CHNL 52	SET RELAY CHNL 51	SET RELAY CHNL 50	SET RELAY CHNL 49	SET RELAY CHNL 48

(Offset \$12) RELAY_CTRL_REG 2*							
Bit 15	Bit 14	Bit 13	Bit 12	Bit 11	Bit 10	Bit 09	Bit 08
SET RELAY CHNL 47	SET RELAY CHNL 46	SET RELAY CHNL 45	SET RELAY CHNL 44	SET RELAY CHNL 43	SET RELAY CHNL 42	SET RELAY CHNL 41	SET RELAY CHNL 40

(Offset \$13) RELAY_CTRL_REG 3*							
Bit 07	Bit 06	Bit 05	Bit 04	Bit 03	Bit 02	Bit 01	Bit 00
SET RELAY CHNL 39	SET RELAY CHNL 38	SET RELAY CHNL 37	SET RELAY CHNL 36	SET RELAY CHNL 35	SET RELAY CHNL 34	SET RELAY CHNL 33	SET RELAY CHNL 32

(Offset \$14) RELAY_CTRL_REG 4*							
Bit 31	Bit 30	Bit 29	Bit 28	Bit 27	Bit 26	Bit 25	Bit 24
SET RELAY CHNL 31	SET RELAY CHNL 30	SET RELAY CHNL 29	SET RELAY CHNL 28	SET RELAY CHNL 27	SET RELAY CHNL 26	SET RELAY CHNL 25	SET RELAY CHNL 24

(Offset \$15) RELAY_CTRL_REG 5*							
Bit 23	Bit 22	Bit 21	Bit 20	Bit 19	Bit 18	Bit 17	Bit 16
SET RELAY CHNL 23	SET RELAY CHNL 22	SET RELAY CHNL 21	SET RELAY CHNL 20	SET RELAY CHNL 19	SET RELAY CHNL 18	SET RELAY CHNL 17	SET RELAY CHNL 16

(Offset \$16) RELAY_CTRL_REG 6*							
Bit 15	Bit 14	Bit 13	Bit 12	Bit 11	Bit 10	Bit 09	Bit 08
SET RELAY CHNL 15	SET RELAY CHNL 14	SET RELAY CHNL 13	SET RELAY CHNL 12	SET RELAY CHNL 11	SET RELAY CHNL 10	SET RELAY CHNL 09	SET RELAY CHNL 08

(Offset \$17) RELAY_CTRL_REG 7*							
Bit 07	Bit 06	Bit 05	Bit 04	Bit 03	Bit 02	Bit 01	Bit 00
SET RELAY CHNL 07	SET RELAY CHNL 06	SET RELAY CHNL 05	SET RELAY CHNL 04	SET RELAY CHNL 03	SET RELAY CHNL 02	SET RELAY CHNL 01	SET RELAY CHNL 00

(Offset \$18) RLY_CONTACT_REG 0*							
Bit 31	Bit 30	Bit 29	Bit 28	Bit 27	Bit 26	Bit 25	Bit 24
RELAY CNTCT 63	RELAY CNTCT 62	RELAY CNTCT 61	RELAY CNTCT 60	RELAY CNTCT 59	RELAY CNTCT 58	RELAY CNTCT 57	RELAY CNTCT 56

(Offset \$19) RLY_CONTACT_REG 1*							
Bit 23	Bit 22	Bit 21	Bit 20	Bit 19	Bit 18	Bit 17	Bit 16
RELAY CNTCT 55	RELAY CNTCT 54	RELAY CNTCT 53	RELAY CNTCT 52	RELAY CNTCT 51	RELAY CNTCT 50	RELAY CNTCT 49	RELAY CNTCT 48

(Offset \$1A) RLY_CONTACT_REG 2*							
Bit 15	Bit 14	Bit 13	Bit 12	Bit 11	Bit 10	Bit 09	Bit 08
RELAY CNTCT 47	RELAY CNTCT 46	RELAY CNTCT 45	RELAY CNTCT 44	RELAY CNTCT 43	RELAY CNTCT 42	RELAY CNTCT 41	RELAY CNTCT 40

(Offset \$1B) RLY_CONTACT_REG 3*							
Bit 07	Bit 06	Bit 05	Bit 04	Bit 03	Bit 02	Bit 01	Bit 00
RELAY CNTCT 39	RELAY CNTCT 38	RELAY CNTCT 37	RELAY CNTCT 36	RELAY CNTCT 35	RELAY CNTCT 34	RELAY CNTCT 33	RELAY CNTCT 32

(Offset \$1C) RLY_CONTACT_REG 4*							
Bit 31	Bit 30	Bit 29	Bit 28	Bit 27	Bit 26	Bit 25	Bit 24
RELAY CNTCT 31	RELAY CNTCT 30	RELAY CNTCT 29	RELAY CNTCT 28	RELAY CNTCT 27	RELAY CNTCT 26	RELAY CNTCT 25	RELAY CNTCT 24

(Offset \$1D) RLY_CONTACT_REG 5*							
Bit 23	Bit 22	Bit 21	Bit 20	Bit 19	Bit 18	Bit 17	Bit 16
RELAY CNTCT 23	RELAY CNTCT 22	RELAY CNTCT 21	RELAY CNTCT 20	RELAY CNTCT 19	RELAY CNTCT 18	RELAY CNTCT 17	RELAY CNTCT 16

(Offset \$1E) RLY_CONTACT_REG 6*							
Bit 15	Bit 14	Bit 13	Bit 12	Bit 11	Bit 10	Bit 09	Bit 08
RELAY CNTCT 15	RELAY CNTCT 14	RELAY CNTCT 13	RELAY CNTCT 12	RELAY CNTCT 11	RELAY CNTCT 10	RELAY CNTCT 09	RELAY CNTCT 08

(Offset \$1F) RLY_CONTACT_REG 7*							
Bit 07	Bit 06	Bit 05	Bit 04	Bit 03	Bit 02	Bit 01	Bit 00
RELAY CNTCT 07	RELAY CNTCT 06	RELAY CNTCT 05	RELAY CNTCT 04	RELAY CNTCT 03	RELAY CNTCT 02	RELAY CNTCT 01	RELAY CNTCT 00

* These registers are not used with the 32-channel board (VRD150) and are not driven by the board.

Control and Status Register (CSR)

The CSR is used to control the relay drivers and a front panel LED. This register has three active bits (15 to 13). The rest of the bits are not used, but they are read back. Bit 15 controls the front panel Fail LED. When a zero is written to this bit, the LED will turn ON. This bit is cleared when power is applied, or after a system reset. However, it is under program control and can be used to locate faulty boards in a system.

Bits 14 and 13 control the relay drivers. Registers that store data control the relays. The outputs of these registers go to the drivers, which then activate the relays. These drivers can be disabled by the CSR. Bit 14 controls the relays going to connector P4 (Channels 1 through 32). Bit 13 controls the relays of P3 (Channels 33 through 64). Writing a zero to either of these bits will disable the drivers associated with the listed output channels. For nonlatching relays, they will go to their normal contact positions (normally open contacts will open and normally closed contacts will close). Like Bit 15, these bits will be cleared when power is applied (or after a system reset) in order to prevent random data from disturbing the field circuitry controlled by these relays.

Relay Control Registers

These registers control the relay drivers and hence the relays. Each bit controls one relay. The relay or output channel for each bit is listed in Table 3-2 on page 3-4. Writing a logic "one" to this bit will activate the set relay coil. This will force the normally closed contact to open and the normally open contact to close. The relay will close its normally closed contact and open the normally open contact whenever a logic "zero" is written to its control bit.

Relay Contact Registers

These registers contain the state of a second set of contacts in the relays. This contact reflects the condition of the contacts, which may take as much as 5.5 msec to finally switch after a change command is sent to its Control Register. The logic level read from this register bit will match the level in the Control Register's bit after the contact has had enough time to settle into its new position. If a logic "one" is written to Control Register 5, Bit 19, channel 19 will switch to its active state. Normally open contacts will close, etc. 7 msec later reading Contact Register 5, Bit 19 and will show a logic "one", just like its counterpart in the Control Register.

Built-in-Test

Built-in-Test is done by reading back the data written to a specific register and comparing it to the data written. All board registers are available to the user at any time. There are two types of testing done with this board, off-line (Testmode) or on-line (real-time).

In Testmode testing, the relay drivers are disabled. This will prevent test data from disturbing the external circuitry. However, it also fails to test the relays themselves. Testmode is useful during initial testing to determine if the board can respond to commands without risking damage to any sensitive controllers or equipment. Since Testmode can be performed at any time, two bits are used in order to keep half of the board active, while the other half is in Testmode.

The Relay Contact Registers are used to permit checking of the relays. These registers show the state of a second set of contacts in each relay. Their logic state will reflect the logic state of the Control Registers after the contacts have stopped bouncing. If the Control Register has a logic "one" in a certain bit, then the Contact Register will also have a logic "one" in the associated bit position. These registers permit testing of all of the components on the board up to the output connectors.

This chapter describes the internal organization of the Relay Board, reviews the general principles of operation, and is divided into the following sections:


- Internal Functional Organization
- Foundation Logic
- Output Registers and Relays
- Built-in-Test (BIT)

Internal Functional Organization

To activate a relay on the board, write a "one" to the address and bit position for that output channel. To check on the "health" of the board, read a register and compare this data to the written data. A Board Identification Register and a Control and Status Register are available for controlling the board.

A block diagram of the board is shown in Figure 4-1 below. The Relay Board has three basic sections: the foundation logic, the output control logic, and the relays. The foundation logic contains the board address decoder and the data steering logic. The output control logic decodes the on-board registers and places the data in the appropriate register or activates the proper register for read accesses. The relays simply place their contacts on the output connectors that will go to the external circuits being controlled.

Figure 4-1: Relay Board Block Diagram

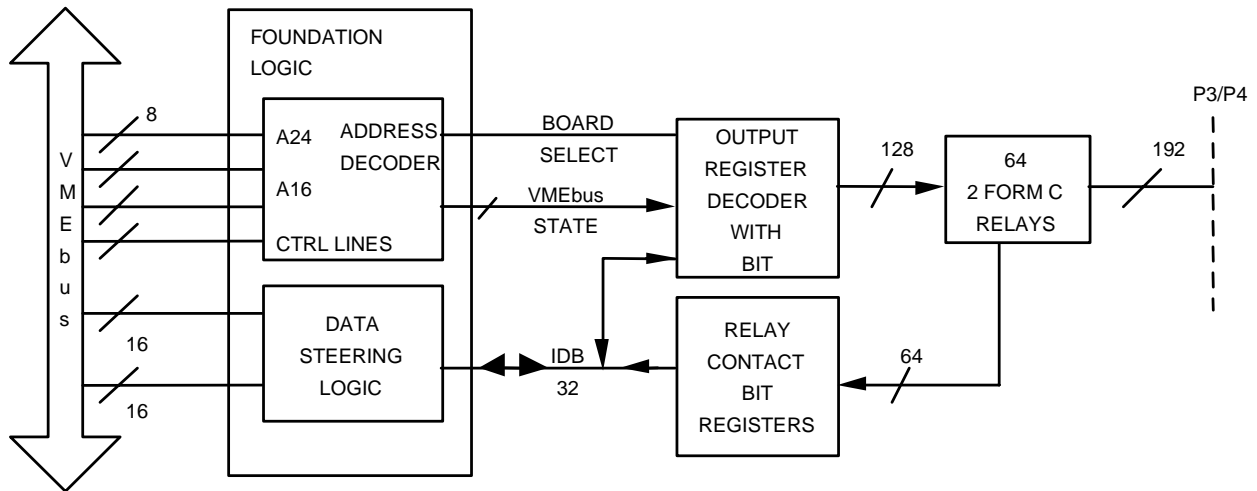

Foundation Logic

The foundation logic provides the proper loading to the VMEbus via components used in building the board. The foundation logic also decides if this board is to respond to a VMEbus data cycle, steers the data to or from the proper on-board registers, and issues DTACK* to the host CPU.

Address Decoding

The address decoder (shown in Figure 4-2 on page 4-5) determines when the board will respond to a VMEbus data transfer cycle. The decoder has three address comparators and their associated board address jumpers in header H1. There are two additional jumpers (also part of H1) involved in the decode function. One of them is the Short/Standard Addressing jumper. The other is the Supervisory/Nonprivileged jumper.

The Short/Standard Addressing jumper determines if the upper eight address lines (A23-A16) will be used in the board's base address. When this jumper is not installed, the upper eight address lines are ignored. This puts the board in the A16 or Short I/O address range. If the jumper is installed, the upper eight lines are used. This jumper and the AM2 (or Supervisory/Nonprivileged) jumper determine what address modifier the board will respond to.

The Supervisory/Nonprivileged jumper has two positions. The positions are labeled $\overline{\text{AM2}}$ and AM2/ $\overline{\text{AM2}}$. Install a jumper in the $\overline{\text{AM2}}$ location when the board is to respond to a nonprivileged access only. Install a jumper at the AM2/ $\overline{\text{AM2}}$ position when the board is to respond to either nonprivileged or supervisory accesses. If a response is desired for supervisory access only, do not install a jumper in either position. **Do not** install both jumpers. If both jumpers are installed, the AM2 line to the VMEbus backplane will be grounded and the system will not work properly.

The rest of the positions in the header H1 are used to establish the base address of the board. Any installed jumper will set the corresponding address line to a logic low in the comparators. This address line is listed next to the jumper position. If the board is set up for Short I/O accesses, any jumpers installed in the upper eight positions (A(16) through A(23)) are ignored. They do not have to be removed.

Data Steering and Register Decoding

Once the decoder decides to respond, `BD_SEL_H` is asserted (driven high). This signal clocks the state of the VMEbus control lines and the four lowest address lines into a register. The outputs of this register are used to decode the internal board functions. The outputs of this decoder (shown in Figure 4-3 on page 4-6) engage data transceivers, who steer the data to the proper internal register. The data transceivers then clock this data into a register or place data on the Internal Data Bus (IDB), depending upon the type of data cycle.

Storing the VMEbus state permits the host to prepare the next transaction while the Relay Board is still processing the present data cycle. These signals are decoded and the proper register(s) are activated. If a write cycle is in progress, the clock signal will store the data from the VMEbus into the selected register(s). The clock signal is delayed long enough for the data to move through the steering logic and be present and stable before the register(s) are clocked. During a read cycle, the proper register(s) have their data placed on the IDB and it is held there until the end of the transfer cycle (when both Data Strobe lines go high).

All of the board's registers can be read from, or written to, at any time. However, data written to read only registers (BDID and Relay Contact Registers) will be lost. The CSR contains control lines that determine what relay drivers are active. The BDID and CSR will be discussed in more detail in the next section.

Once the board determines it is to respond to a bus cycle, `DTACK*` is asserted (driven low) 150 nsec (nanoseconds) later. This tells the host when the board is done with the data. The host withdraws its Data Strokes by driving them high. The Relay Board sees this and rearms its board select logic, then waits for the next data cycle.

Figure 4-2: Board Select Logic


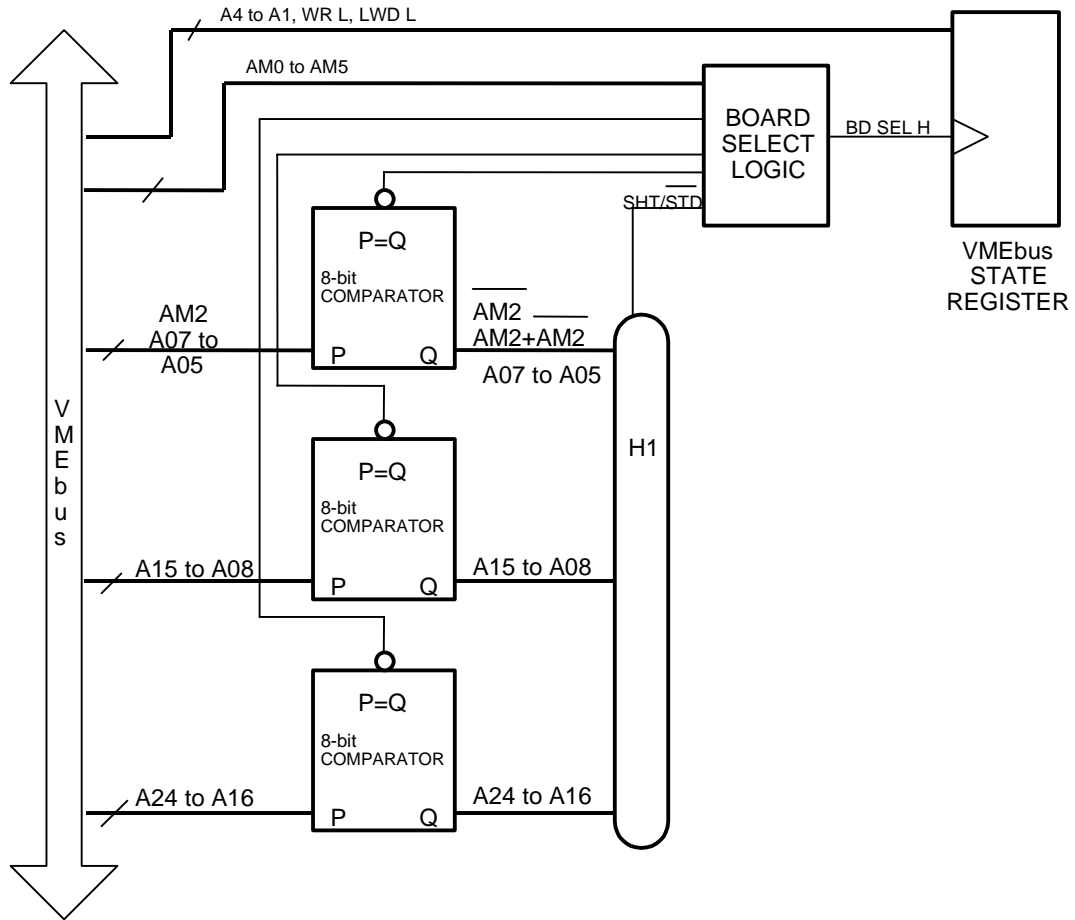


Figure 4-3: Board Register Decoder and Data Steering Logic

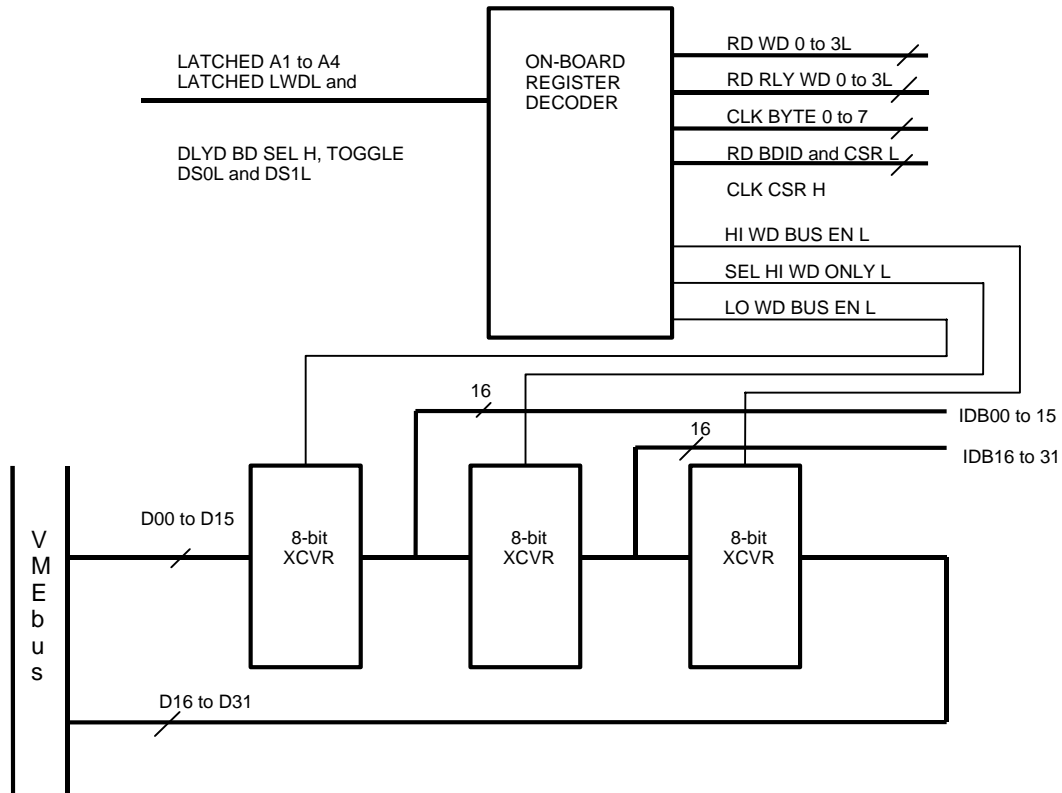


Board ID and Control and Status Registers

The BDID is a read only register located at the base address of the board. It has a fixed value of 1BXX HEX. The XX part of this word is not driven by the board and the user should ignore what is read here. The BDID is used by system software to identify the boards in a system for automatic system configuration. If data is written to this address, the board will respond with DTACK*, but the data will not be stored.

The CSR is located at the next word location (see Figure 4-4 below shows for BDID and CSR circuitry). The upper three bits (see Chapter 3 for more details) are used by the board and the rest are ignored. The most significant bit (Bit 15) controls the Front Panel Fail LED. When this bit is low, the LED is ON (when it is high, the LED is OFF). The next two bits control the relay drivers. Each bit controls one half of the board's relays and are broken up by the output connectors. Bit 14 controls the relays going to P4 (Channels 1 through 32). Bit 13 controls the relays going to P3 (Channels 33 through 64).

When these bits are high, the drivers are engaged and data written to the Output Registers will control the relays. Write a "one" where a relay is to be activated (i.e. the Normally Open contact is closed, and the Normally Closed contact is open). When a relay is deactivated, the opposite condition exists. If the control bits in the CSR are low, the drivers are tri-stated and the relays are not affected by the data stored in the Output Registers.

Figure 4-4: Board ID and CS Registers

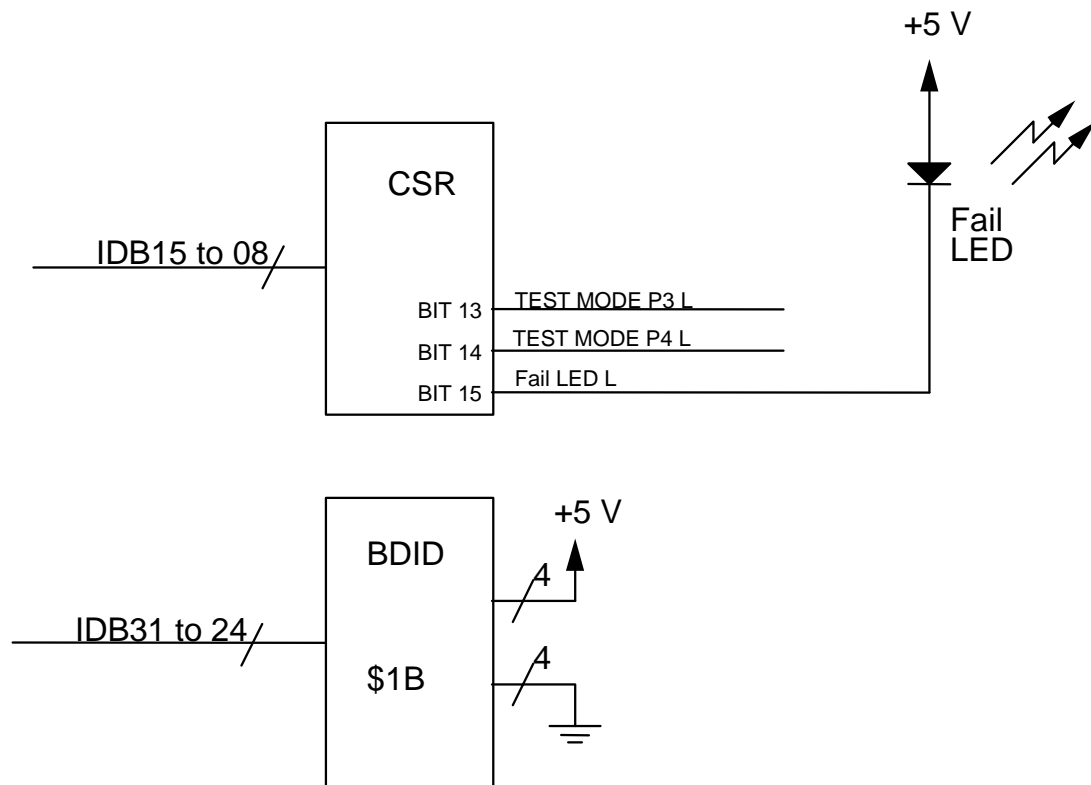

Output Registers and Relays


A typical Output Register, relay driver-to-relay circuit is shown in Figure 4-5 on page 4-9. These relays use two coils. One coil is the set coil, which activates the relay. The other is the reset coil. The reset coil will deactivate the relay when it is energized, making it unwise to have both coils active at the same time. To prevent this, the Output Register's pin goes to a buffer and an inverter driver, leaving only one of the coils energized. The two drivers' outputs are controlled by the Test Mode bit in the CSR. These drivers cannot be disengaged arbitrarily. They must be active long enough for the relays to change state and latch (7 msec maximum). If the drivers are tri-stated before the relay has had enough time to latch, the relay might switch back to its previous state.

To aid the host in determining the state of the relay, a second contact is brought out to the bus via the Relay Contact Register. This contact reflects the state of the relay and is useful in test mode. While in test mode, the Output Registers can be changed without affecting the relays.

Built-in-Test (BIT)

Built-in-Test is done by reading the appropriate register (Output Registers normally written to by host). To check the Output Registers, perform a read of the same address, then compare the data read to the data written to determine the "health" of these registers. This kind of testing will check most of the circuitry on the board; however, the relays and their drivers are not tested this way. To test relays and their drivers, use the "Relay Contact Register." These registers return the state of the relay contacts based upon the state the Output Control Register used on the relays. If a "one" is read from the Contact Register, the relay is set or activated, and the data in the Control Register for this relay should also be a "one." The opposite conditions should be found for relays that are reset or deactivated. This discussion assumes that ample time is given to the relays for switching states.

Figure 4-5: Relay and Control Logic

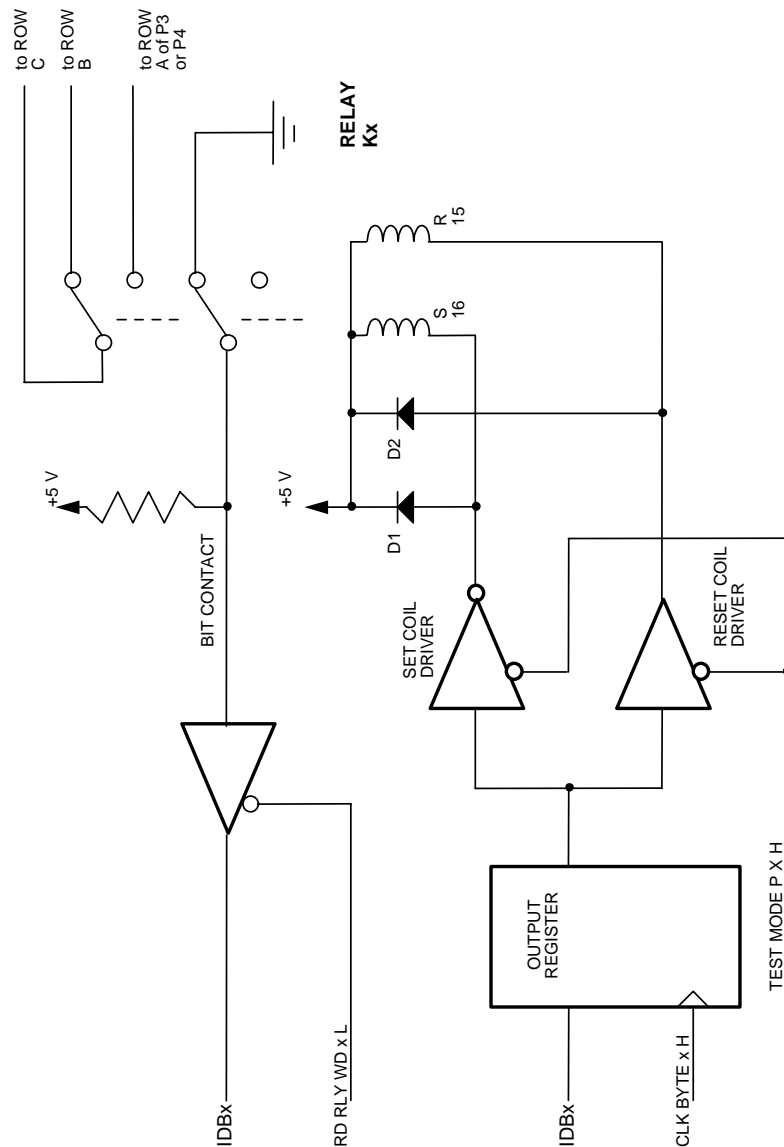

Chapter 5

Maintenance

This chapter provides information relative to the care and maintenance of the Relay Board product.

If the product malfunctions, verify the following:

- Software
- System configuration
- Electrical connections
- Jumper or configuration settings
- Boards are fully inserted into their proper connector location
- Connector pins are clean and free from contamination
- No components of adjacent boards are disturbed when inserting or removing the board from the chassis
- Quality of cables and I/O connections

User level repairs are not recommended. Contact your authorized GE Fanuc distributor for a Return Material Authorization (RMA) Number. **This RMA Number must be obtained prior to any return.**